KATRI Industry & Environment Research Center
232-22, Yongdu-dong, Dongdaemun-gu, Seoul, Korea http://www.katri.re.kr
TEL : +82-2-3668-3084 FAX : +82-2-3668-2907

TEST REPORT

APPLICANT : ACOURETE Co., Ltd.

KATRI NO.: SS07-AN000264
GATE : Apr. 11. 2007.
PAGE (S) : 1 OF 1

SAMPLE DESCRIPTION : ONE(1) SAMPLE OF MAT RESIN
RECEIVED DATE : Apr. 05. 2007 ***

TEST ITEM	TEST RESULTS #
■ Flammability	
The Fire Services Act 50.	clause5 the Ministry of Home Affairs notification 1997-40
Afterflame time(S)	1.9
Afterglow time(S)	0.0
Char length(cm)	2.3
Char area(㎠)	3.7

Note) 1. Meckel burner method
2. Flame height : 6.5cm
3. Flame duration : 120s
4. All over the specimen's char length and char area(which were changed after flammability test) were measured.
5. Required flammability standards for "Interior decorations"
   1) Afterflame time : Less than 10s
   2) Afterglow time : Less than 30s
   3) Char length : Less than 20cm
   4) Char area : Less than 10cv

#1

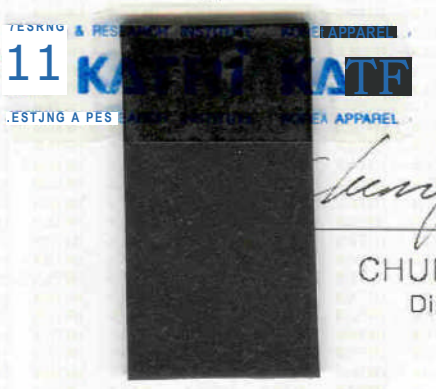

CHUNG SEOK YOO
Director General

The results on this sheet are offered in good faith and are derived from the samples submitted. They represent the testing carried out by our competent staff in our up to date laboratory.